


TANGENT

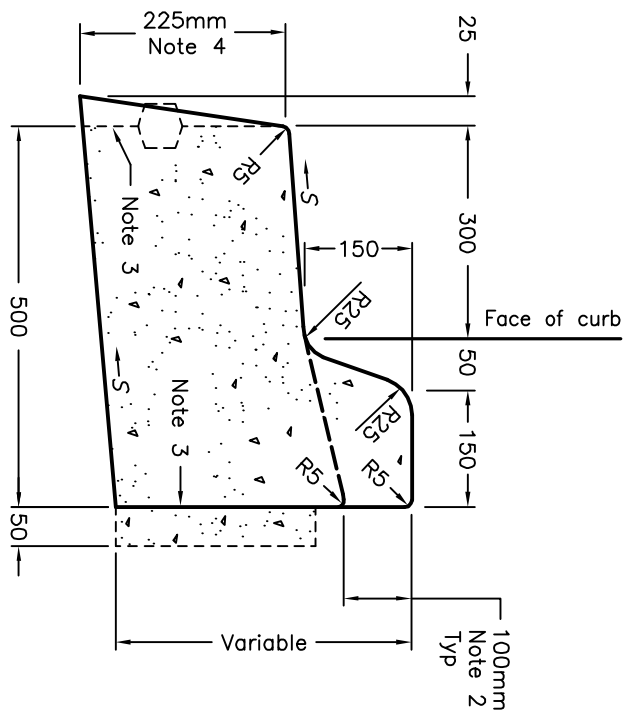

SUPERELEVATED

LEGEND:

S – Rate of pavement super-elevation in percent, %.

NOTES:

- 1 Flexible and composite pavement shall be placed 5mm above the adjacent edge of gutter.
- 2 When sidewalk is continuously adjacent, the dropped curb at entrances shall be reduced to 75mm.
- 3 For slipforming procedure a 5% batter is acceptable.
- 4 For composite pavement the depth of concrete curb shall be adjusted to depth of concrete pavement.
- 5 When tie bars are specified, refer to OPSD 552.010 and 552.020 for details.

- A Treatment at entrances shall be according to OPSD 351.010.
- B Outlet treatment shall be according to the OPSD 610 Series.
- C The transition from one curb type to another shall be a minimum length of 3.0m, except in conjunction with guide rail where it shall be according to the OPSD 900 Series.
- D All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING		Nov 2012	Rev	2
CONCRETE BARRIER CURB WITH STANDARD GUTTER		-----		
		OPSD 600.040		

