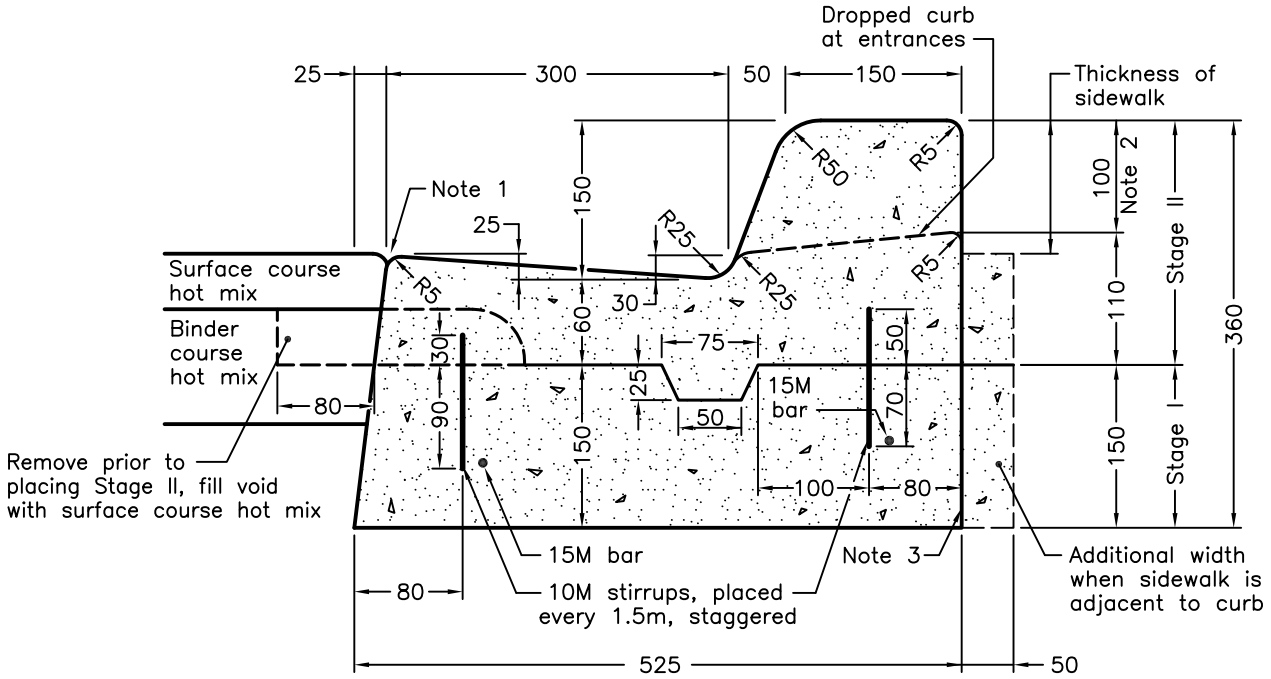



STIRRUP DETAIL

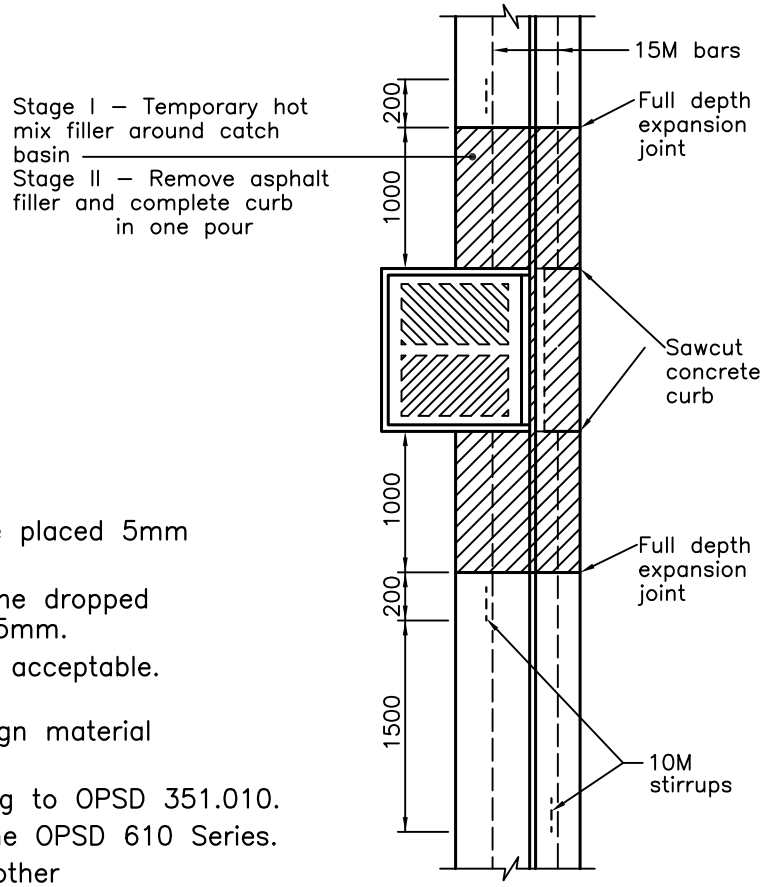

DETAIL AT CATCH BASIN

NOTES:

1 Flexible and composite pavement shall be placed 5mm above the adjacent edge of gutter.

2 When sidewalk is continuously adjacent, the dropped curb at entrances shall be reduced to 75mm.

3 For slipforming procedure a 5% batter is acceptable.

A Stage I surface shall be cleaned of foreign material prior to placement of Stage II material.

B Treatment at entrances shall be according to OPSD 351.010.

C Outlet treatment shall be according to the OPSD 610 Series.

D The transition from one curb type to another shall be a minimum length of 3.0m, except in conjunction with guide rail, when it shall be according to the OPSD 900 Series.

E All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING	Nov 2012	Rev	2
CONCRETE BARRIER CURB WITH STANDARD GUTTER TWO STAGE CONSTRUCTION			**OPSD – 600.070**