



SIZE OF DROP PIPE		
SEWER ID	DROP PIPE ID	APPLICATION
200	200	Storm and Sanitary
250	200	Storm and Sanitary
300	250	Storm and Sanitary
375	300	Storm and Sanitary
450	375	Storm
525	450	Storm
600	525	Storm
675	600	Storm

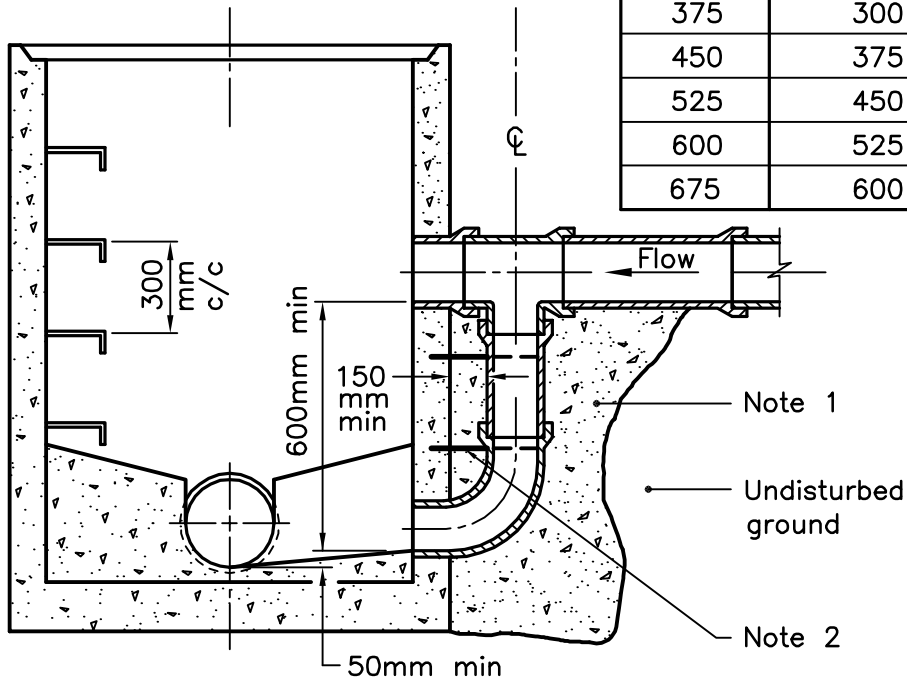

SECTION A-A

NOTES:

- Concrete shall be placed to undisturbed ground and the outside face of the maintenance hole, but there shall be a minimum of 150mm of 15MPa concrete around the drop pipe.
 - Concrete shall be secured to the maintenance hole with 450mm long, 13mm diameter threaded rods and drilled expansion anchors down either side of the drop pipe at 300mm centres.
- A All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING	Nov 2016	Rev 3	
CAST-IN-PLACE MAINTENANCE HOLE DROP STRUCTURE TEE	-----	-----	
	OPSD 1003.010		