



CAP DETAIL

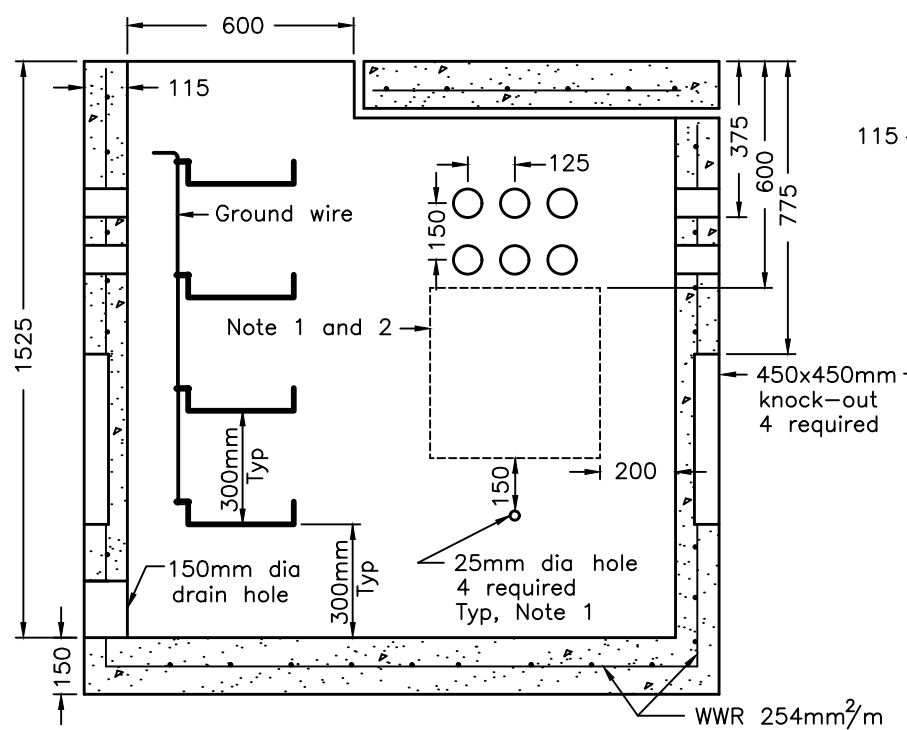

SECTION A-A

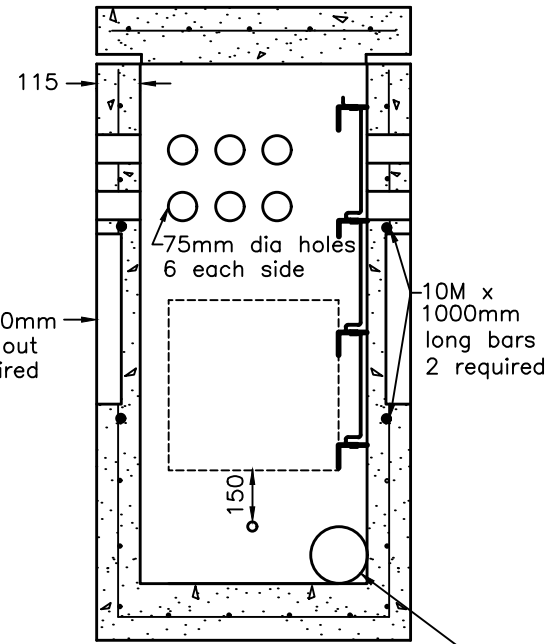

SECTION B-B

NOTES:

- 1 For general installation details see OPSD 2117.010.
- 2 For duct installation profiles see OPSD 2103.020.
- A Minimum cover for reinforcing steel shall be 35mm external surface, 25mm internal surface.
- B All reinforcing shall be cut to suit openings.
- C All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING

Apr 2022 Rev 2

**ELECTRICAL MAINTENANCE HOLE
PRECAST CONCRETE
600 x 1450mm**



OPSD 2111.020