



**EXTRA LOW VOLTAGE CABLE TO DETECTOR CABLE SPlicing DETAIL**

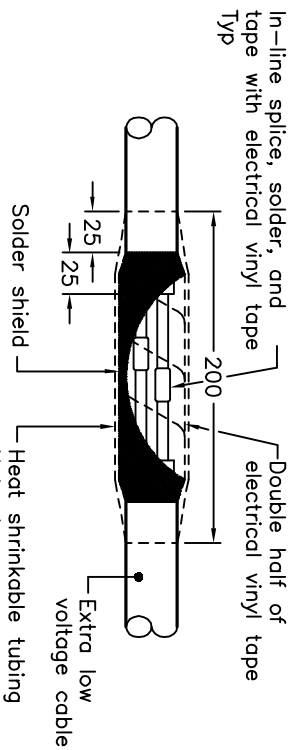


**EXTRA LOW VOLTAGE CABLE SPlicing DETAIL**

**NOTES:**

- 1 Heat shrinkable tubing shall be 2.4mm wall thickness, 19mm diameter, and 600 volt.
- 2 Splices shall be of suitable diameter and length as shown in Table 1 and installed according to manufacturer's instructions.
- A Splices shall not be used unless shown on the wiring diagrams, quantity sheets, or layout drawings, unless otherwise approved by the Engineer.
- B All dimensions are in millimetres unless otherwise shown.

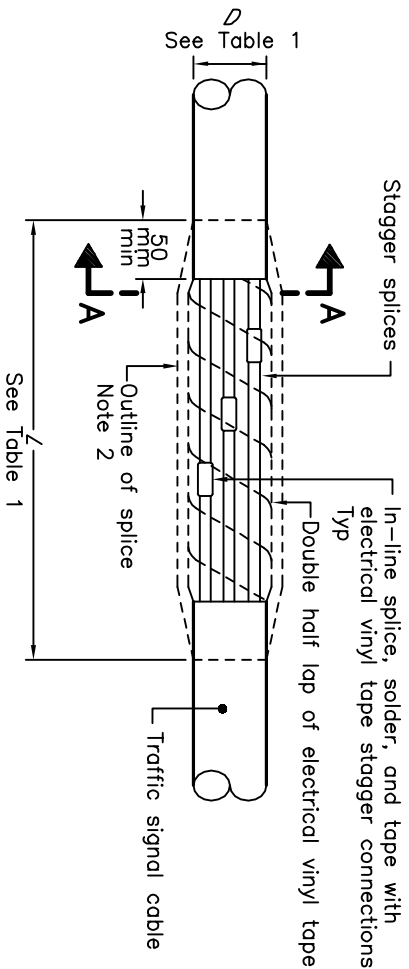

**TRAFFIC SIGNAL CABLE SPlicing DETAIL**

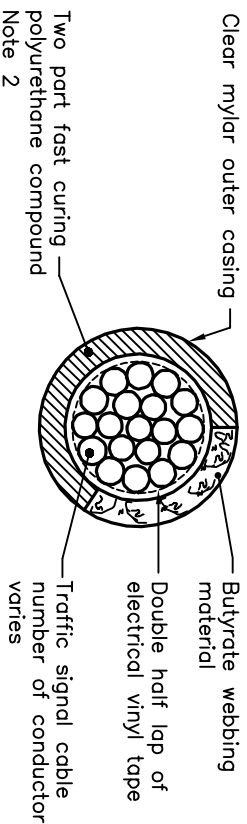

**SECTION A-A**

**TABLE 1**

TRAFFIC SIGNAL CABLE	D	L
4 Conductor	12	300
7 Conductor	16	450
12 Conductor	21	450
19 Conductor	25	500

ONTARIO PROVINCIAL STANDARD DRAWING

Nov 2013

Rev 1

SPICES FOR

TRAFFIC SIGNAL CABLE AND

EXTRA LOW VOLTAGE CABLE



OPSD 2530.01