


PLAN

SIZE OF DROP PIPE	
SEWER ID	DROP PIPE ID
200	200
250	200
300	250
375	300

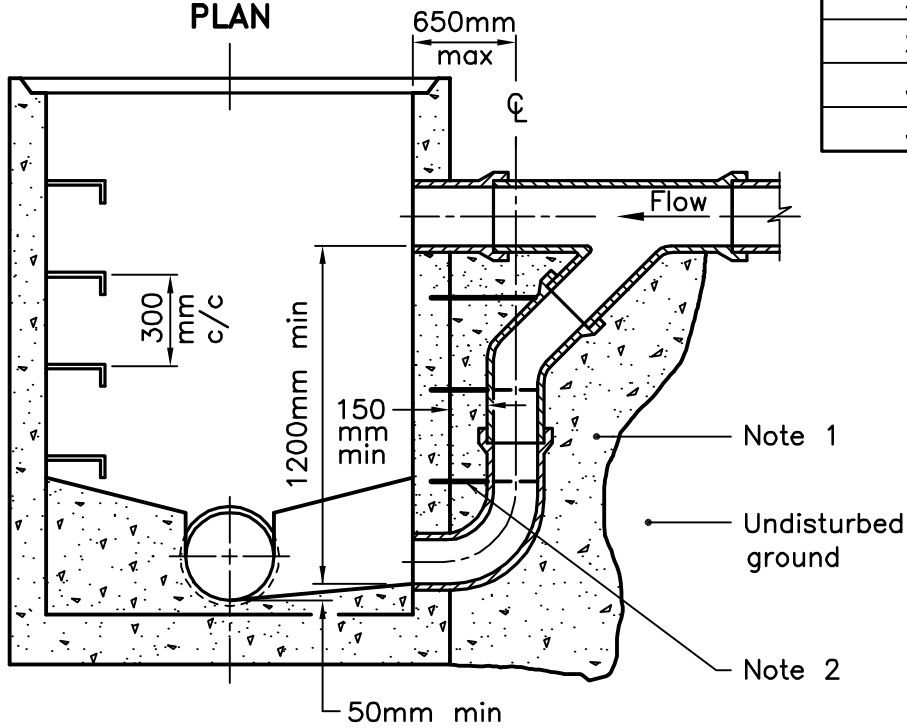

SECTION A-A

NOTES:

- 1 Concrete shall be placed to undisturbed ground and the outside face of the maintenance hole, but there shall be a minimum of 150mm of 15MPa concrete around the drop pipe.
  - 2 Concrete shall be secured to the maintenance hole with 450mm long, 13mm diameter threaded rods and drilled expansion anchors down either side of the drop pipe at 300mm centres.
- A All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING	Nov 2016	Rev 3	
CAST-IN-PLACE MAINTENANCE HOLE DROP STRUCTURE WYE	-----	-----	
	OPSD 1003.020		