



PLAN

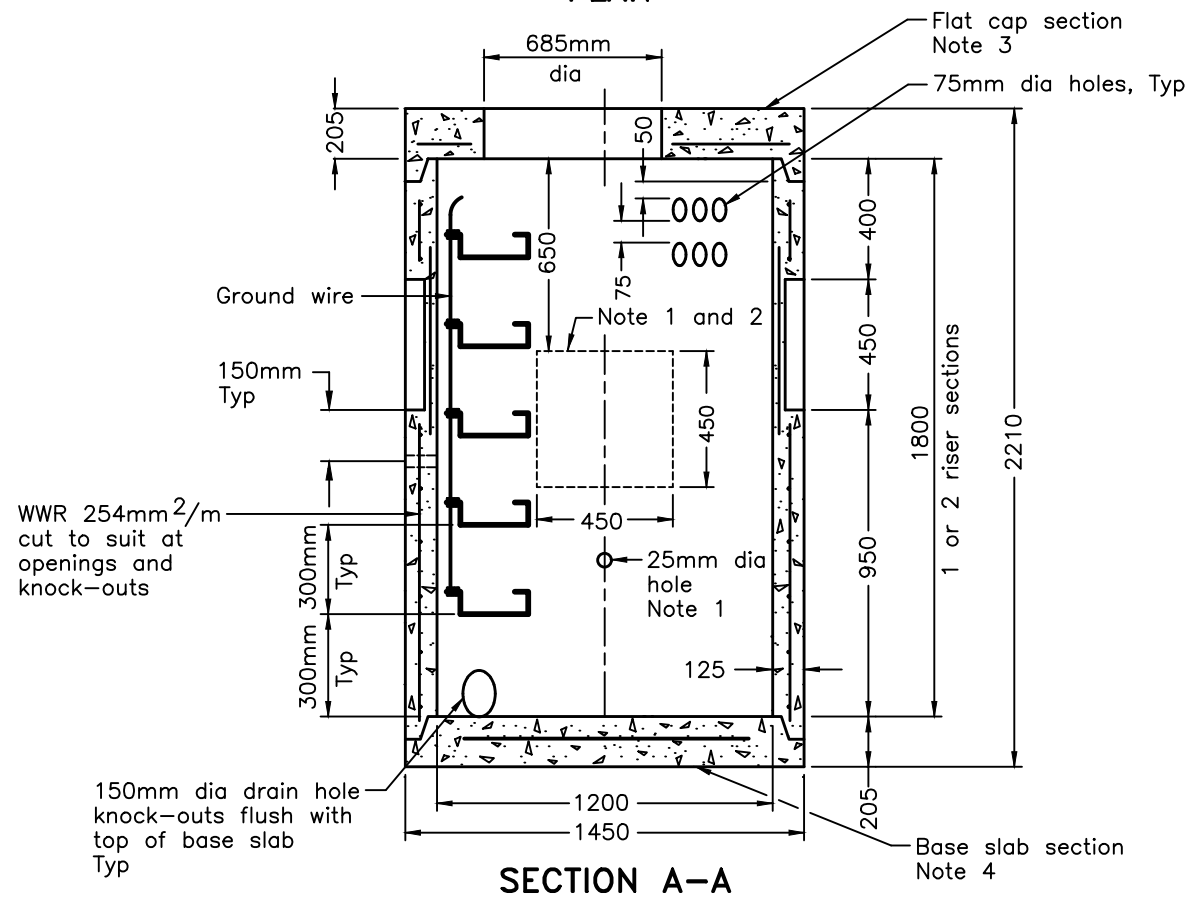

SECTION A-A

NOTES:

- 1 For general installation details see OPSD 2117.010.
- 2 For duct installation profiles see OPSD 2103.020.
- 3 For details and reinforcing of flat cap section and base slab section see OPSD 701.030.
- A Minimum cover for reinforcing steel shall be 35mm external surface, 25mm internal surface.
- B All reinforcing shall be cut to suit openings.
- C All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING	Apr 2022	Rev 2	
ELECTRICAL MAINTENANCE HOLE PRECAST CONCRETE 1200mm DIA	----- -----		
OPSD 2111.030			