


NOTES

1. THE WATER METER SHALL BE READILY ACCESSIBLE.
2. THE WATER METER LOCATION SHALL BE LOCATED WHERE THE SERVICE PIPE ENTERS A BUILDING'S FULL BASEMENT OR IN ANOTHER AREA OF A BUILDING OR LOCATION APPROVED BY THE REGION OF DURHAM.
3. WATER METERS SHALL BE INSTALLED, SEALED, REPLACED MAINTAINED, REPAIRED, TESTED, INSPECTED AND REMOVED ONLY BY EMPLOYEES OR AGENTS OF THE REGION OF DURHAM.
4. A FULL PORT, STOP AND WASTE CORPORATION VALVE (GATE OR BALL TYPE) ON THE INLET SIDE OF A WATER METER SHALL BE INSTALLED.
5. SELECT A LOCATION FOR THE RECEPTACLE WHICH IS AS CLOSE AS POSSIBLE TO THE METER AND WHICH PROVIDES A SUITABLE POINT FOR A DRILLED HOLE. LOCATION OF RECEPTACLE SHOULD BE ACCESSIBLE, PREFERABLY BESIDE AN ELECTRIC OR GAS METER ON THE DRIVEWAY SIDE OF THE BUILDING.
6. IF THE 2 WIRE RECEPTAL-TO-ENCODER CABLE RUNS NEAR OR INTO THE GROUND, PROTECT IT FROM LAWN MAINTENANCE EQUIPMENT BY PLACING THE WIRE INSIDE A PIECE OF PVC PIPE. ANCHOR THE PIPE INTO THE GROUND AND STRAP IT TO THE MOUNTING SURFACE.
7. PROVIDE 1.0 m EXCESS WIRE AT EACH END FOR SUBSEQUENT HOOKUP AT RECEPTACLE AND AT METER.
8. STEEL PIPE OF ANY TYPE SHALL NOT BE USED AS A SPACER PRIOR TO THE WATER METER BEING INSTALLED.



ALL DIMENSIONS IN MILLIMETRES EXCEPT WHERE NOTED.

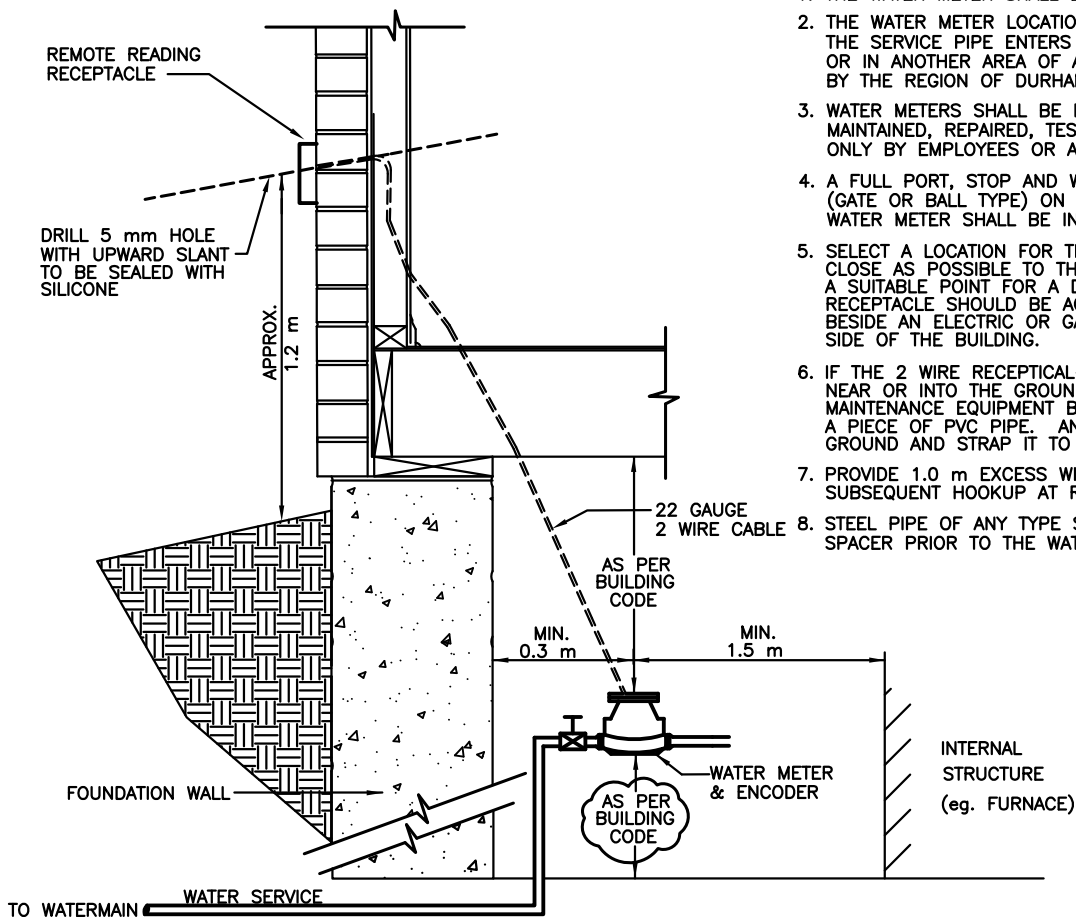

**METER, VALVE,
PRO READ ARB RECEPTACLE AND
WIRE INSTALLATION**

DWG. DATE: 1995 02
 REVISION NO.: 6
 REV. DATE: 2013 04
 SCALE: N.T.S.

S-240.010